


**Great Lakes Bay Region Travel Demand Model
 2040 Model Network Including Capacity Projects
 2040 Bay County PM Peak (3-6pm) Capacity Deficiencies
 Volume/Capacity Ratio (V/C) .8-.99 is Approaching Capacity
 Volume/Capacity Ratio (V/C) > 1 is Above Capacity
 Level of Sevice D Capacities Were Used
 January 25, 2012**

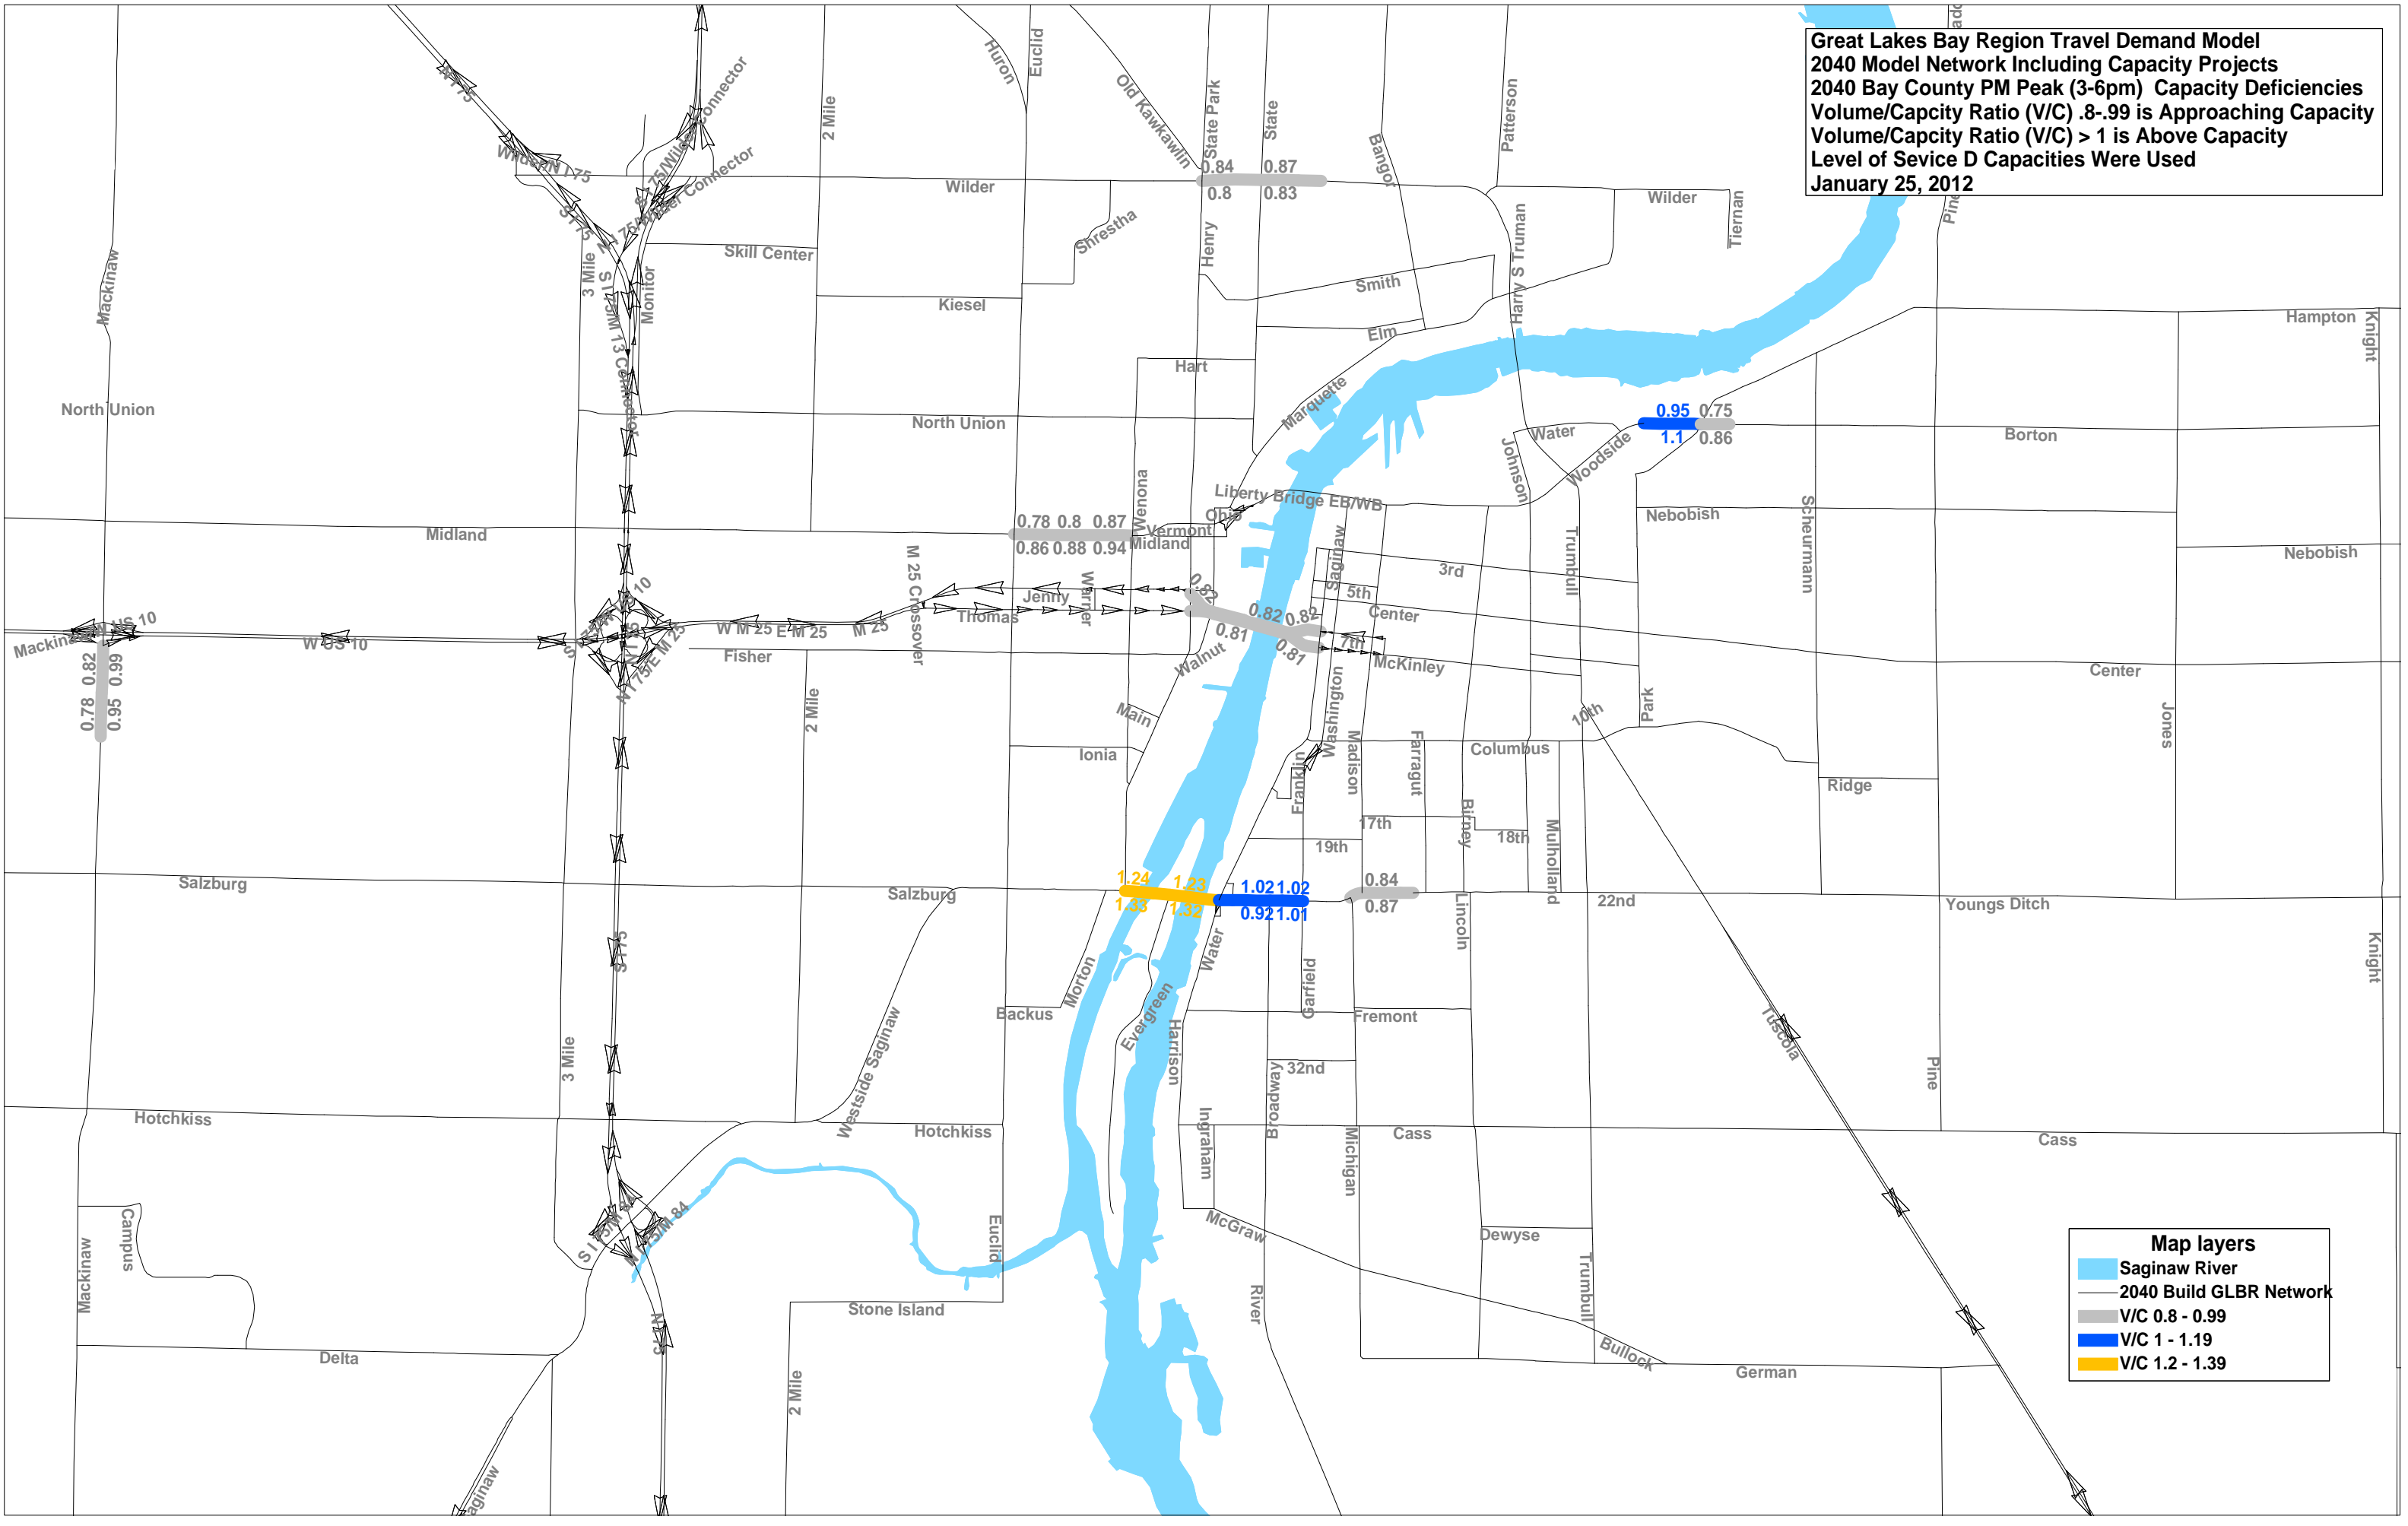

Map layers

- Saginaw River
- 2040 Build GLBR Network
- V/C 0.8 - 0.99
- V/C 1 - 1.19
- V/C 1.2 - 1.39